




VERTICAL SECTION THROUGH ANODE BED
SCALE 1:50

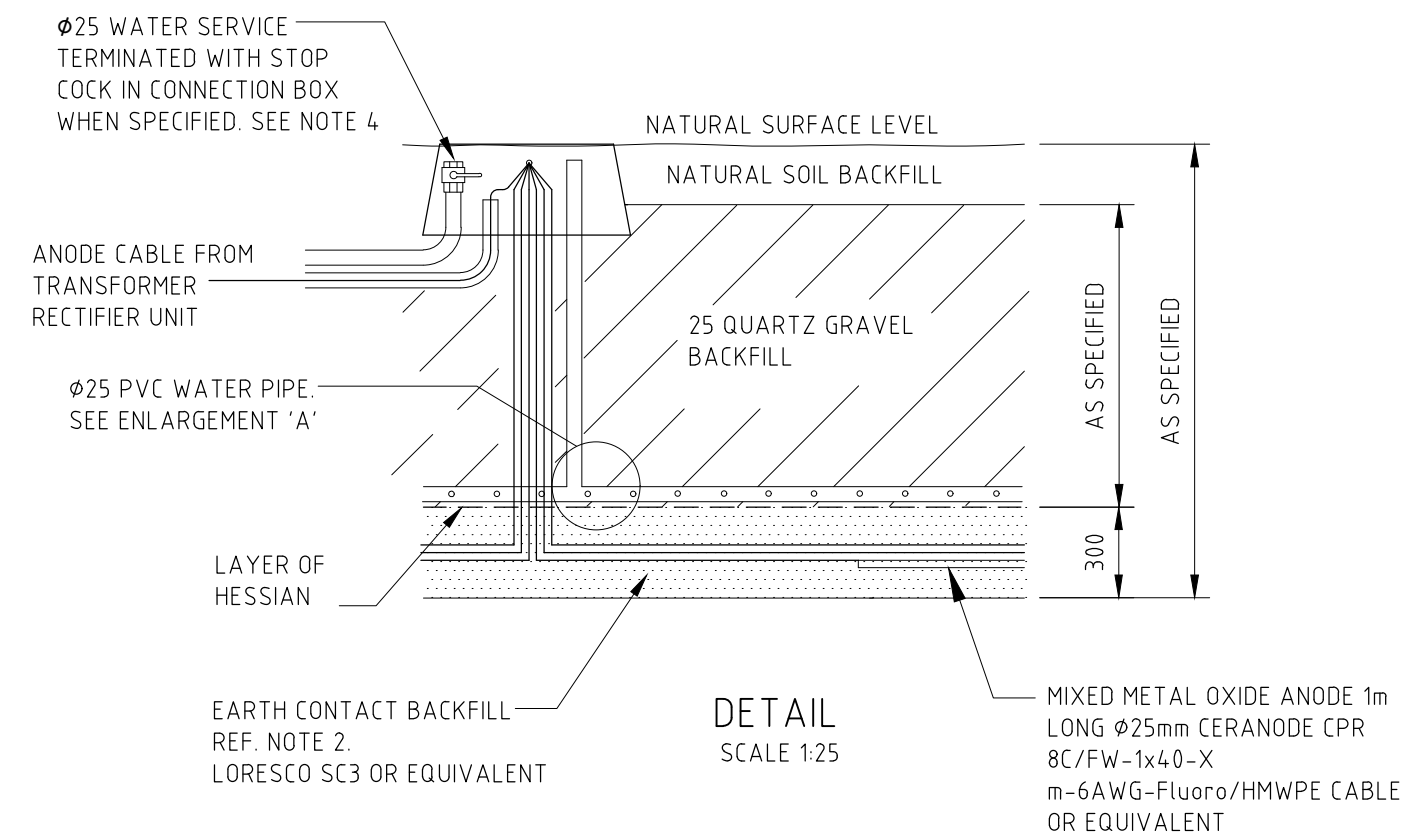

DETAIL
SCALE 1:25

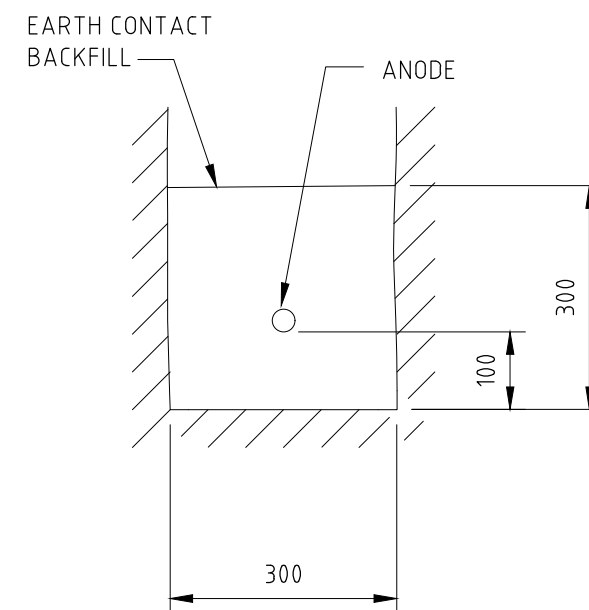


SECTION THROUGH BASE OF
ANODE TRENCH
SCALE 1:10

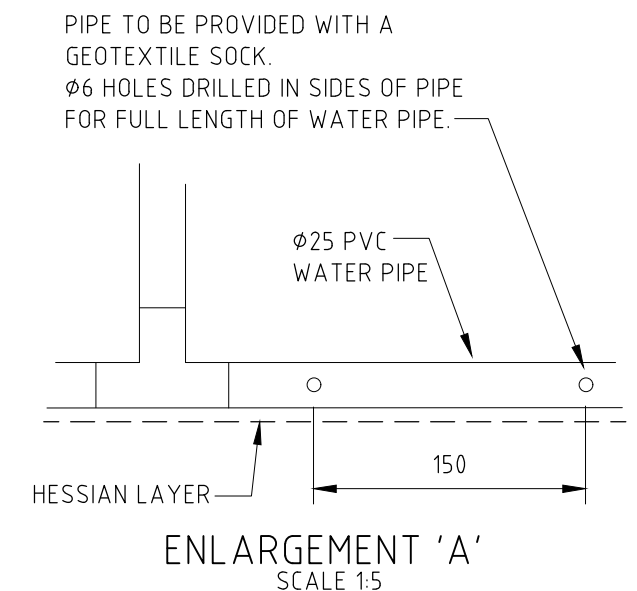

NOTES

1. CONCRETE RING FOR STREET BOX SHALL NOT SIT DIRECTLY ON CONDUIT OR WATER PIPE.
2. IF TRENCH IS NOT FILLED WITH WATER, EARTH CONTACT BACKFILL SHALL BE THOROUGHLY WETTED BEFORE INSTALLING QUARTZ GRAVEL.
3. LENGTH OF TRENCH = 3000 x (NO. OF ANODES SPECIFIED). LENGTH = 18000 FOR THE 6 ANODES AS SHOWN.
4. SEE SHEET 74 DRIPPER SYSTEM TO ANODES FOR DETAILS (UP TO BALL VALVE).

REVISION PANEL					DESIGN PANEL		 SA WATER STANDARD DRAWING HORIZONTAL ICCP ANODE BED GENERAL ARRANGEMENT CATHODIC PROTECTION	A3 SHT SIZE TOTAL SHEETS: PROJECT No: MAXIMO ID: SUPERSEDES: DRAWING NUMBER STD-04-00001_21	1.0 REVISION	
REV	DATE	DRN	DETAILS	APR	CURRENT REV 03/06/22	DESIGNED: 03/06/2022				AUTHORISED:
						R. SALAZAR ROMERO				KINGSLEY BROWN
						DRAWN: 03/06/2022				SIGNATURE:
						C. DOUGALL				
1.0	03/06/22	CD	ISSUED FOR USE	RSR		REVIEWED: 03/06/2022	KINGSLEY BROWN	This drawing is the property of the SOUTH AUSTRALIAN WATER CORPORATION and shall not be copied or modified in part or in whole without authorization.		
CURRENT REV CONTRACTOR:					CURRENT REV PROJECT:		CONTRACTOR:			